



The  
Electrical  
Power  
Engineers

**Qual-Tech Engineers, Inc.**  
201 Johnson Road – Building #1 · Suite 203  
Houston, PA 15342-1300

Phone 724-873-9275 – Fax 724-873-8910  
www.QualTechEng.com

# FLICKER IN ARC FURNACE APPLICATIONS

Equations are given in this document for estimating flicker in arc furnace applications. These equations have generally been developed based upon analysis and experience.

## 1.0 Flicker Limits in Terms of P<sub>st</sub> and P<sub>lt</sub>

*IEEE Standard 1453 – IEEE Recommended Practice for Measurement and Limits of Voltage Fluctuations and Associated Light Flicker on AC Power Systems* is the key standard with regard to flicker. Some of the key points of this document are noted as follows. Other details are available in the standard.

1. P<sub>lt</sub> is the measure of long-term perception of flicker obtained for a two-hour period. This value is made up of 12 consecutive P<sub>st</sub> values.
2. P<sub>st</sub> is the measure of short-term perception of flicker obtained for a ten-minute interval.
3. As a general guideline, P<sub>st</sub> and P<sub>lt</sub> should not exceed the planning levels given in Table 1 more than 1% of the time (99% probability level) with a minimum assessment period of one week.

**Table 1 – Planning levels for P<sub>st</sub> and P<sub>lt</sub> in MV, HV, and EHV power systems**

	Planning levels	
	MV	HV-EHV
<b>P<sub>st</sub></b>	<b>0.9</b>	<b>0.8</b>
<b>P<sub>lt</sub></b>	<b>0.7</b>	<b>0.6</b>

4. For LV and MV power systems the flicker levels listed in Table 2 are recommended and are based on 95% probability levels.

**Table 2 – Compatibility levels for P<sub>st</sub> and P<sub>lt</sub> in LV and MV power systems**

	Compatibility levels
<b>P<sub>st</sub></b>	<b>1.0</b>
<b>P<sub>lt</sub></b>	<b>0.8</b>

## 2.0 Calculation of P<sub>st</sub>

A formula that is often used to estimate P<sub>st99%</sub> in arc furnace applications is given as follows:

$$P_{st99\%} = K_{st} \times (S_{ccf}/S_{ccn}) \quad \text{EQ (1)}$$


where  $K_{st}$  = Characteristic emission coefficient for P<sub>st</sub>, ranging from 48 to 85 with a mean value of 60 for 230V, 50 Hz systems as reported by the IUE (International Union for Electroheat)  
 $S_{ccf}$  = Short circuit level at the arc furnace leads  
 $S_{ccn}$  = Short circuit level of the network at the PCC  
 $\%V_D = S_{ccf}/S_{ccn} \times 100\%$  (percent voltage drop at the PCC)

Typically:  $P_{st99\% (120V)} = 0.8 \times P_{st99\% (230V)}$   
or  
 $K_{st(120V)} = 0.8 \times K_{st(230V)}$   
 $P_{st95\%} = 0.85 \times P_{st99\%}$

## 3.0 Example

The following examples and comments are noted:

1. For  $K_{st} = 60$  and  $P_{st99\%} = 1.0$ , the maximum percent voltage drop at the PCC would equal 1.67% from EQ (1).
2. For  $K_{st} = 60$  and  $P_{st99\%} = 0.8$  (which is the recommended planning limit in IEEE Standard 1453 for HV-EHV systems), the maximum percent voltage drop at the PCC would equal 1.33%.
3. Historically, the percent voltage drop at the PCC was used in many countries as the criteria for design. The limits were  $\geq 1.6\%$ .
  - a. Great Britain used 1.6% at voltages above 132 kV and 2.0% at lower voltages.
  - b. The curve in Figure 1 suggests voltage drop limits in the range of 2.2% to 3.1%, depending upon the MW size of the furnace. This characteristic was based on the observation that larger furnaces are smoother in operation.
  - c. Therefore, the limit of  $P_{st99\%} = 0.8$ , which corresponds to a voltage drop of approximately 1.3%, is more restrictive compared to the previous percent voltage drop limits noted above.

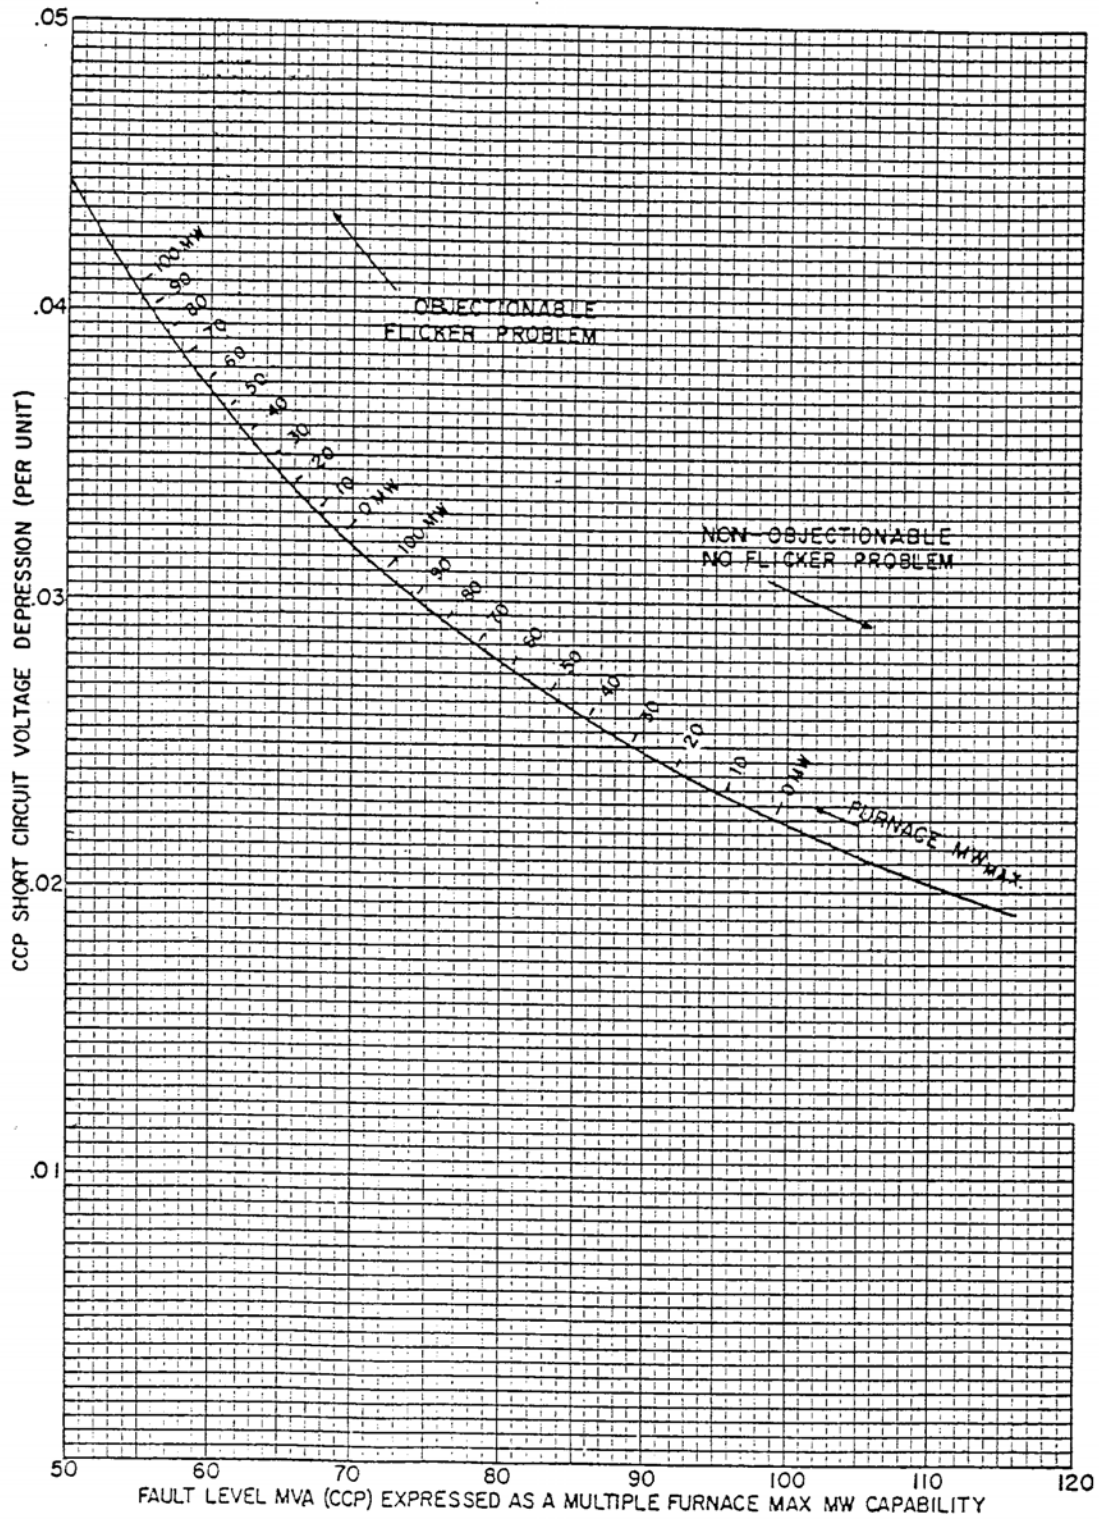

Fault level/ $MW_{MAX}$  ratios and accompanying short circuit voltage depression.

**Figure 1**

## 4.0 Static Var Compensator (SVC)

When flicker is excessive, the typical method of reducing the flicker is to add a static var compensator (SVC) to the system. This is a thyristor controlled reactor (TCR) in parallel with filter capacitor banks. The SVC can generally reduce the flicker level ( $P_{st99\%}$ ) by a factor of 2. The SVC is a mature and reliable technology, which has been used predominantly in arc furnace and transmission applications since the 1970's.

### 4.1 Voltage Drop and SVC's

The voltage drop due to the operation of the arc furnace is caused predominantly by the var flow to the furnace. The worst condition occurs when the furnace electrodes are shorted. The purpose of the static var compensator (SVC) is to supply capacitive vars to offset the inductive vars drawn by the furnace system and, therefore, to minimize the voltage drop on the system.

1. The maximum useful Mvar size of the SVC would generally be the maximum vars drawn by the furnace system. It is possible that being a little larger than that could be helpful if the MW flow is also contributing significantly to the voltage drop.
2. The second key issue is that the SVC must respond fast but not too fast.
  - a. A voltage drop must occur before the SVC can know to respond. Also, the current in the SCR must go through zero before the SVC can change its response. Therefore, a response time of 0.5 to 2.0 cycles would tend to be the minimum response time. With a delay of 0.5 to 2.0 cycles a voltage drop will always occur, but the SVC will limit the duration of the voltage drop.
  - b. The response time of the SVC cannot be too fast or else the SVC will be over shooting or responding erroneously to the change in system voltage.

### 4.2 Typical Arc Furnace Parameters

Typical arc furnace circuit parameters tend to be in the following ranges:

1. The peak furnace MW value is typically in the range of 0.8 to 0.9 times the furnace transformer MVA rating.
2. The peak furnace Mvar value is typically in the range of 1.5 to 1.75 times the furnace transformer MVA rating.

Arc furnace circuits on the order of 100 MVA typically have an X/R ratio of 10 to 15 from the utility source to the shorted electrodes. Approximately 80% to 90% of the circuit resistance (R) is from the furnace transformer primary to the shorted electrodes. In this analysis, references to the "furnace MW" and to "MW to the furnace circuit" are referring to the total MW as measured at the primary of the furnace transformer at 34.5 kV. On the order of 6% to 10% of this MW value is associated with the equipment losses from the furnace transformer primary to the shorted electrodes. Approximately 90% to 94% of this MW value is associated with the arc itself.

### 4.3 Estimating the Mvar Size of the SVC

If the flicker is excessive in a given application, a static var compensator (SVC) is often used. A typically sized SVC reduces the flicker by about 50%. The following formula is often used to estimate the effectiveness of an SVC on the flicker:

$$R_{SVC} = 1 + 0.75 \times (S_{SVC}/S_f) \quad \text{EQ (2)}$$

where

- $R_{SVC}$  = Flicker reduction factor
- $S_{SVC}$  = SVC Mvar
- $S_f$  = Furnace MVA  
= ~ 1.2 x Maximum Furnace MW

This formula is believed to be a reasonable approximation up to  $S_{SVC}/S_f = 2$ . At  $S_{SVC}/S_f = 2$ ,  $R_{SVC} = 2.5$ . A reduction factor near 2 is typical. A reduction factor greater than 3 is not believed to be possible with conventional SVC design. An optimized classic SVC would generally reduce the flicker by approximately 50% with a Mvar rating on the order of 1.6 to 1.8 x the maximum MW of the furnace.

To achieve  $P_{st99\%} = 0.8$ ,  $R_{SVC} = P_{st99\%/w/o\ SVC}/0.8$ . From this relationship the Mvar size of the SVC is estimated as follows from equations (1) and (2):

$$S_{SVC} = (((P_{st99\%/w/o\ SVC}/0.8) - 1)/0.75) \times S_f \quad \text{EQ (3)}$$

For a given SVC Mvar size, the resultant  $P_{st99\%/w/SVC}$  can be estimated as follows:

$$P_{st99\%/w\ SVC} = (P_{st99\%/w/o\ SVC}) / (1 + 0.75 \times (S_{SVC}/S_f)) \quad \text{EQ (4)}$$

For high X/R systems, the maximum useful size of the SVC is approximately equal to the maximum Mvar drawn by the furnace. In systems with significant resistance values, higher Mvar values may be helpful. Equations (2), (3), and (4) are to generally be used within the bounds of the maximum Mvar that could be drawn by the system.

### 5.0 Static Synchronous Compensators (STATCOM)

STATCOM's began to be used in the 1980's and 1990's to solve transmission operation problems due to the restrictions on the construction of new transmission lines. It is a shunt device that can supply vars to the power system faster than an SVC. The response time of the STATCOM is on the order of a 1 millisecond as compared to 0.5 to 2.0 cycles for an SVC. Since it is on the order of 10 times faster, it also has the potential to control the flicker better. It is believed to be able to reduce the flicker by a factor of 4 to 6 compared to 2 for an SVC. Although it is a technology that has been used since the 1980's to the 1990's, the technology of the electronic components is constantly changing on the order of every five years. Also, there is very limited experience with STATCOM's in electric arc furnace applications.